

	<b>PROGETTISTA</b>  <b>Tecnologia Ricerca Rischi</b>	<b>COMMESSA</b> NQ/R22178	<b>UNITA'</b> -
	<b>LOCALITA'</b> RAVENNA (EMILIA ROMAGNA)	<b>DIS-MEC-D-13015</b>	
	<b>PROGETTO / IMPIANTO</b> FSRU Ravenna e Collegamento alla Rete Nazionale Gasdotti		<b>Rev.</b> 0

Rif. TRR: 72341

**EMERGENZA GAS**  
**INCREMENTO DI CAPACITÀ DI RIGASSIFICAZIONE (DL 17.05.2022, n. 50)**  
**FSRU Ravenna e Collegamento alla Rete Nazionale Gasdotti**


**Rapporto Preliminare di Sicurezza**  
**per la fase di Nulla Osta di Fattibilità (NOF)**  
**ai sensi del D.Lgs. 105/15**

**ALLEGATO C.7.11-C**  
**Planimetria Classificazione Aree A Rischio Di Esplosione FSRU**

0	Emissione per permessi	A. Visigoti	A. Romano	G. Romano	06/07/2022
<b>Rev.</b>	<b>Descrizione</b>	<b>Elaborato</b>	<b>Verificato</b>	<b>Approvato</b>	<b>Data</b>



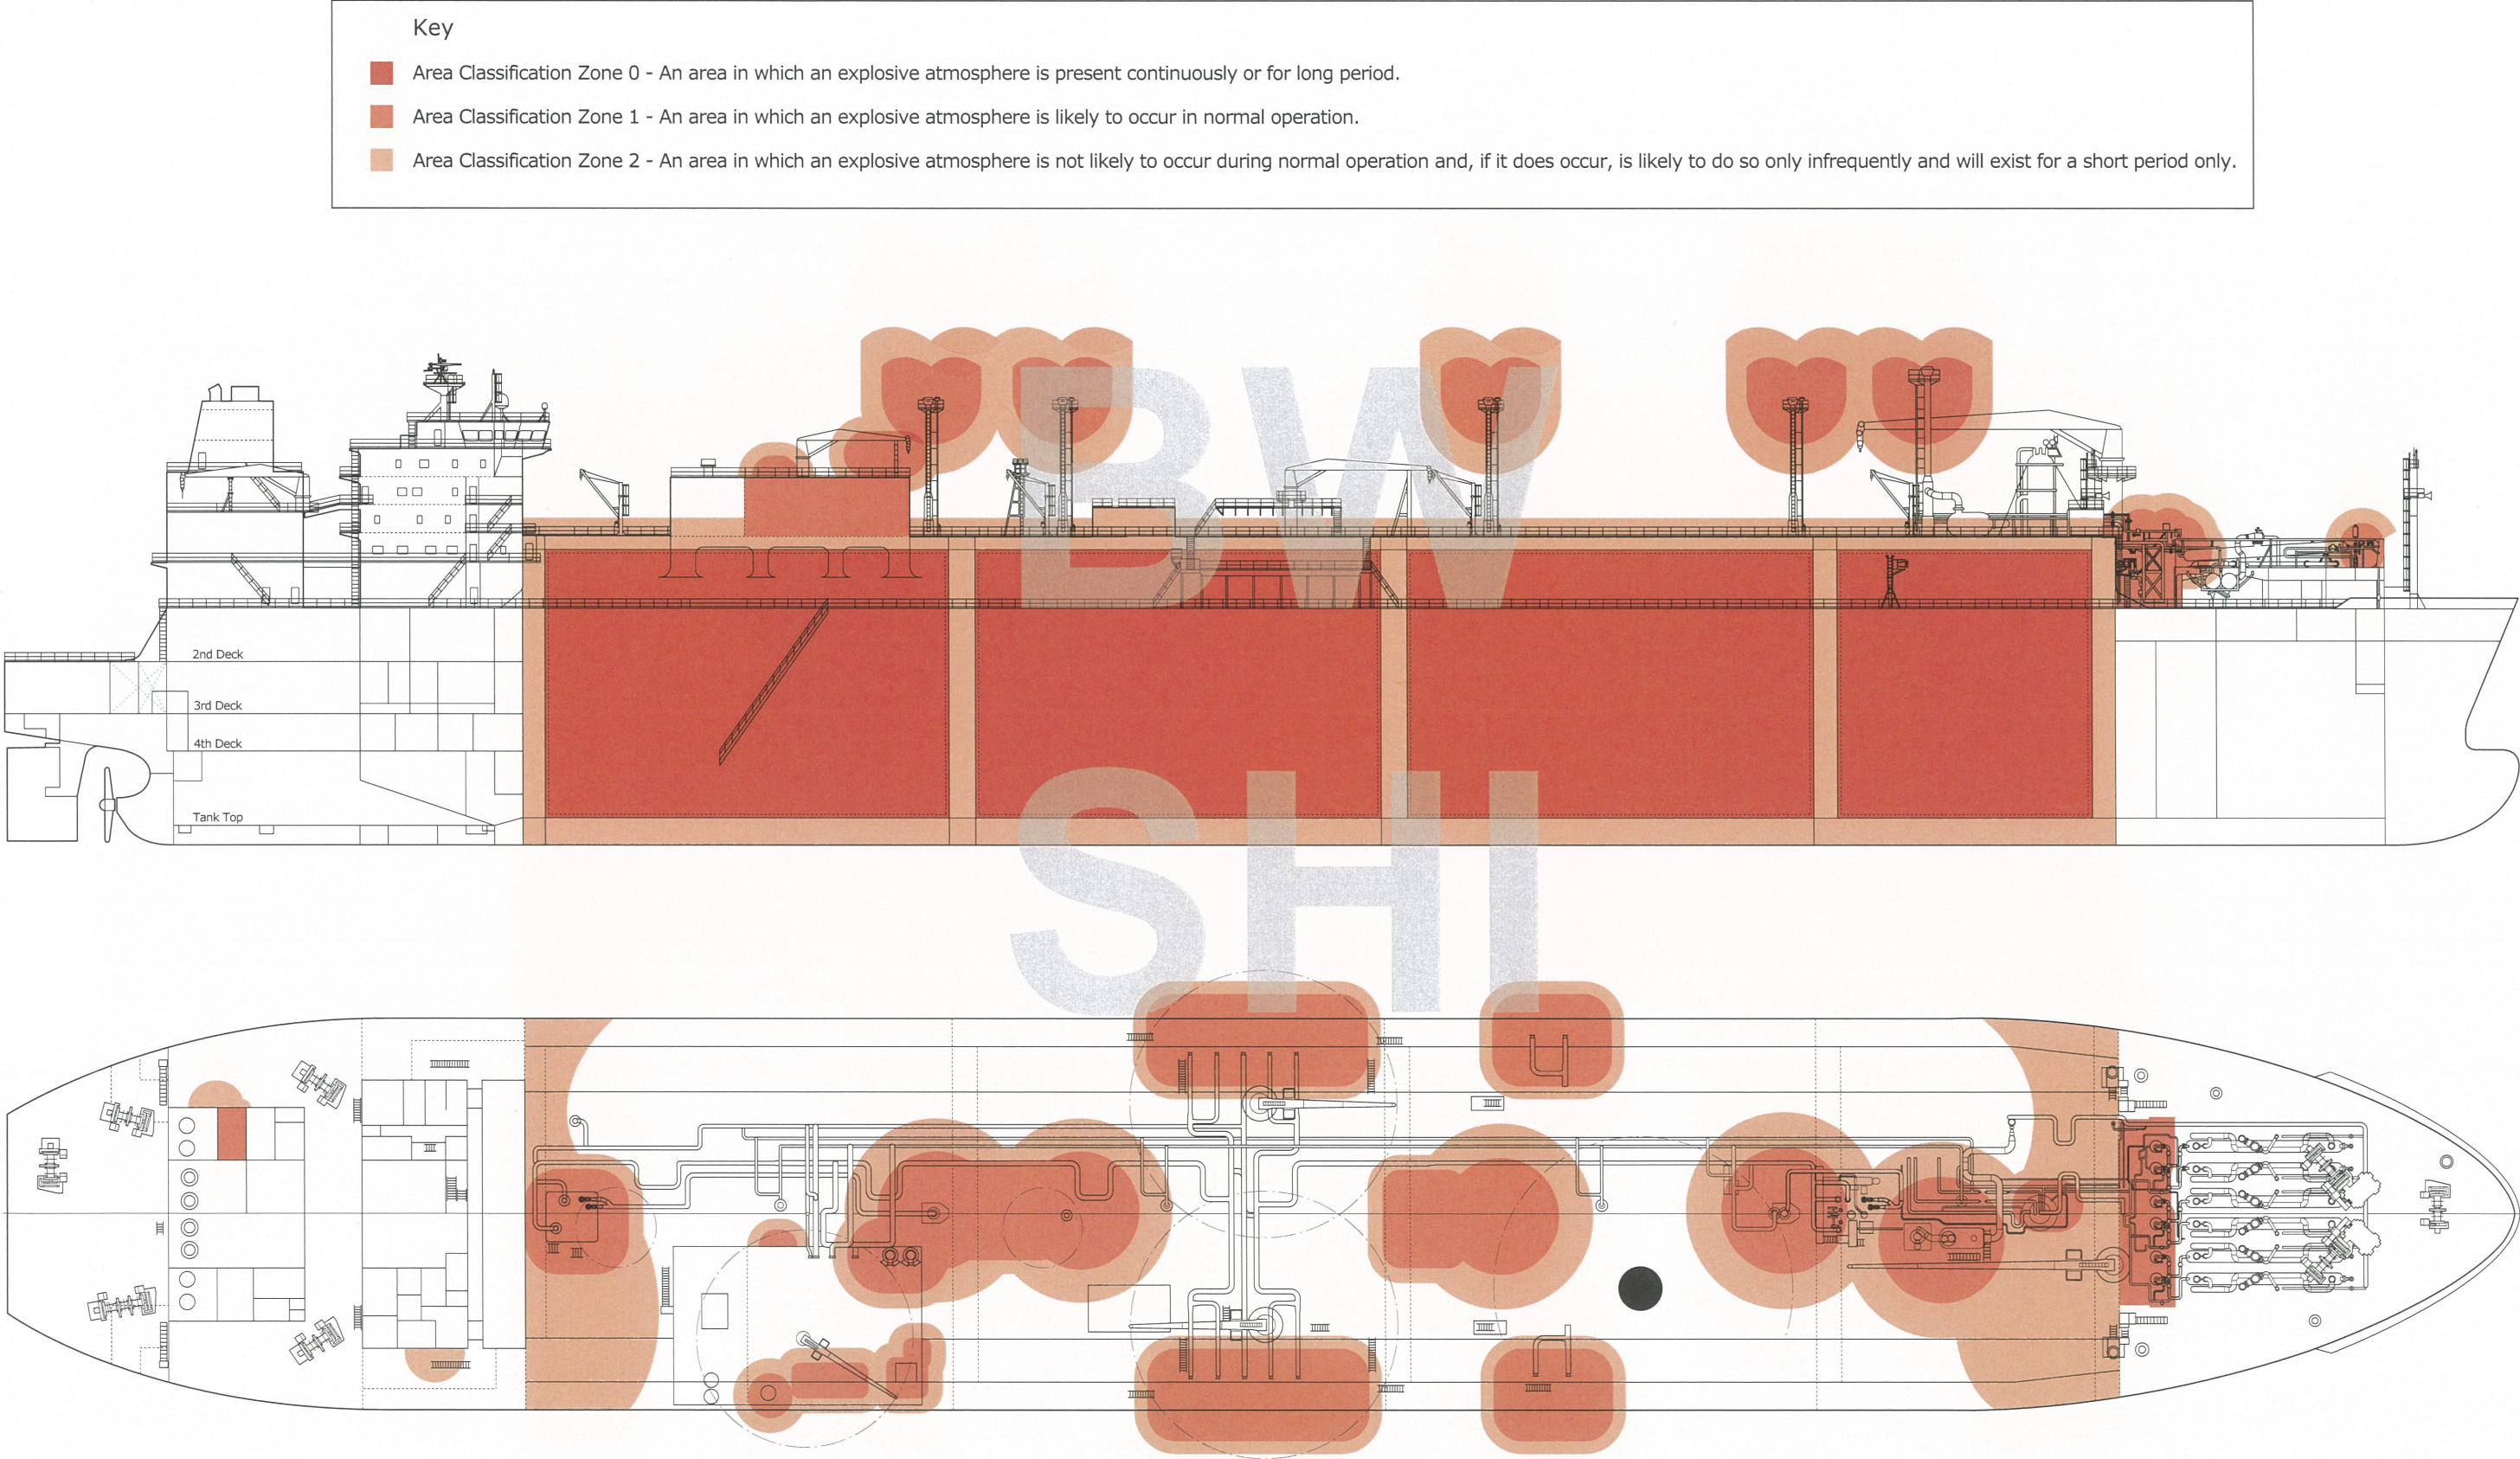


Illustration 1.4a Hazardous Areas Plan





## Illustration 1.4b Hazardous Areas Plan - Midship

### Key

-  Area Classification Zone 0 - An area in which an explosive atmosphere is present continuously or for long period.
-  Area Classification Zone 1 - An area in which an explosive atmosphere is likely to occur in normal operation.
-  Area Classification Zone 2 - An area in which an explosive atmosphere is not likely to occur during normal operation and, if it does occur, is likely to do so only infrequently and will exist for a short period only.

